


SARTELL  Valves &
Controls

**SEAT ADJUSTMENT KIT
20-120" BAW AWWA
BUTTERFLY VALVES
WITH EPOXY-RETAINED SEAT**

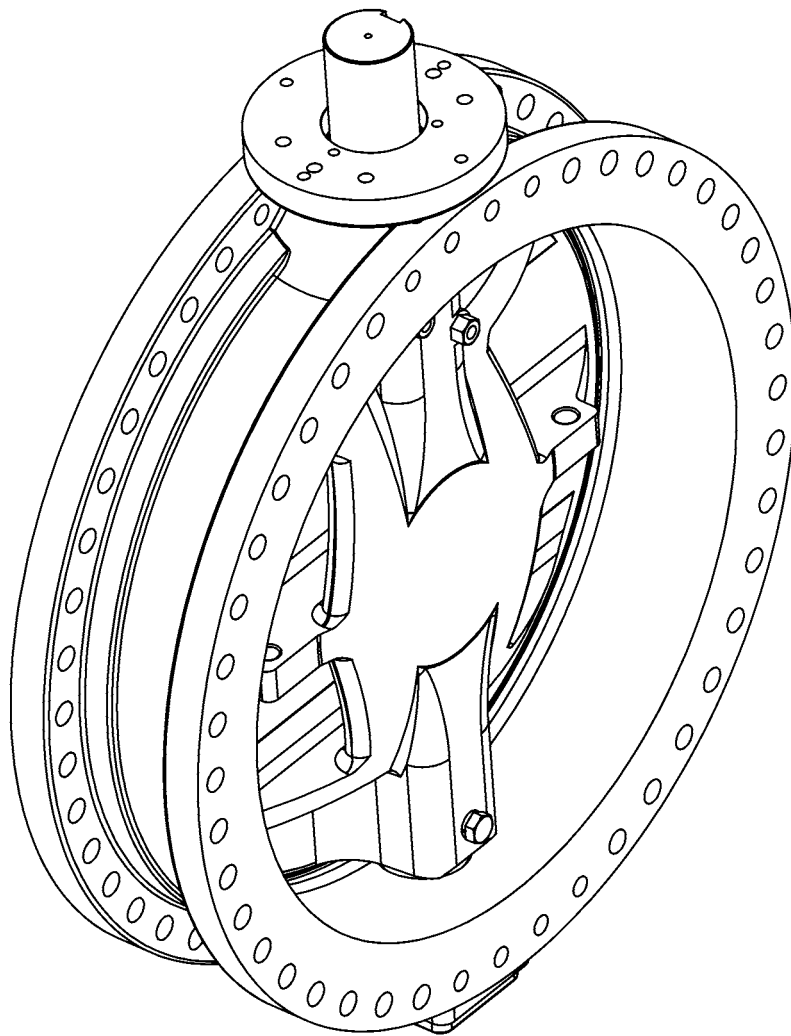

Instruction **DS10376**
July 2008

SARTELL Valves & Controls **Seat Adjustment Kit** **20-120" BAW AWWA Butterfly Valves**

Instructions

These instructions provide information about the Seat Adjustment Kit for BAW AWWA Butterfly Valves with epoxy-retained seats. They are for use by personnel who are responsible for installation, operation and maintenance of BAW AWWA Butterfly Valves.

Safety Messages

All safety messages in the instructions are flagged with an exclamation symbol and the word Caution, Warning or Danger. These messages indicate procedures that must be followed exactly to avoid equipment damage, personal injury or death. Safety label(s) on the product indicate hazards that can cause equipment damage, personal injury or death.

Safety label(s) on the product indicate hazards that can cause equipment damage, personal injury or death. If a safety label becomes difficult to see or read, or if a label has been removed, please contact SARTELL Valves & Controls for replacement label(s).



WARNING!

Personnel involved in the installation or maintenance of valves should be constantly alert to potential emission of pipeline material and take appropriate safety precautions. Always wear suitable protection when dealing with hazardous pipeline materials. Handle valves, which have been removed from service with suitable protection for any potential pipeline material in the valve.

Inspection

Your Seat Adjustment Kit has been packaged to provide protection during shipment; however, it can be damaged in transport. Carefully inspect the unit for damage upon arrival and file a claim with the carrier if damage is apparent.

Parts

Recommended spare parts are listed on the assembly drawing. These parts should be stocked to minimize downtime.

Order parts from your SARTELL Valves & Controls sales representative, or directly from SARTELL Valves & Controls. When ordering parts, please include the 7-digit part number and 4-digit revision number (example: **9999999R000**) located on the data plate attached to the valve assembly. Also include the part name, the assembly drawing number, the balloon number and the quantity stated on the assembly drawing.

SARTELL Valves & Controls Service

SARTELL Valves & Controls service personnel are available to install, maintain and repair all SARTELL Valves & Controls products. SARTELL Valves & Controls also offers customized training programs and consultation services.

For more information, contact your local SARTELL Valves & Controls sales representative or visit our website at www.sartellvalves.com.

Table of Contents

Seat Adjustment ----- 4
Equipment List ----- 4
Setup ----- 4
Preparing the Epoxy ----- 4
Injecting the Epoxy ----- 5
Waste Disposal ----- 6

Seat Adjustment

Seat adjustment is accomplished by injecting epoxy between the rubber seat and the existing epoxy, forcing the seat tighter against the disc. Read the entire instructions before performing the epoxy injection.

Equipment List

- The epoxy injection kit consists of:
- Epoxy Resin and Catalyst
- Injection Gun
- 1/8" NPT Coupling
- Needles

Setup

1. Remove and discard the nozzle from the extension tube.
2. Install the 1/8" NPT coupling on the extension tube and install the needle on the opposite end of the coupling.
3. Install the extension tube on the grease gun and tighten all the fittings.
4. Remove the end of the grease gun with the extension tube.

Preparing the Epoxy

The ratio of catalyst to resin is 1 part catalyst to 7.7 parts resin by volume and 1 part catalyst to 9.5 parts resin by weight. Ensure everything is ready before combining the resin and the catalyst.



WARNING!

The epoxy will begin to cure as soon as the catalyst is mixed into the resin. The pot life is 30 minutes. Do not mix epoxy until ready to use.

1. Check the expiration date on the epoxy kit.
2. If product is expired order replacement epoxy from DeZURIK (part number 1285429).
3. Open the 2641-40 resin and thoroughly stir contents—try to limit the amount of air stirred into resin.
4. Using clean containers, pour one unit of catalyst into one container and 7.7 units of resin into another container.



WARNING!

When mixed, the epoxy causes a chemical reaction that generates heat and smoke. If the depth of the mixed epoxy is greater than 2", the heat from this reaction can start a fire. Mix the resin and catalyst only in a well-ventilated area and pour uncured epoxy into multiple containers to reduce depth of mixture.

5. Take containers to point of use and combine the catalyst with the resin.
6. Stir the mixture by hand until completely blended—try to limit the amount of air stirred into resin.

Seat Adjustment *(Continued)*

7. Pull the T-handle of the injection gun back and pour the mixture into the gun.
8. Put the end of the gun with the extension tube back on and tighten assembly.
9. Pump the handle until a small amount of epoxy comes out of the needle.

Injecting the Epoxy

1. Ensure valve is in the closed position and under pressure.
2. Select an injection site that is about $\frac{3}{4}$ " to one side of leak. See Figure 1.

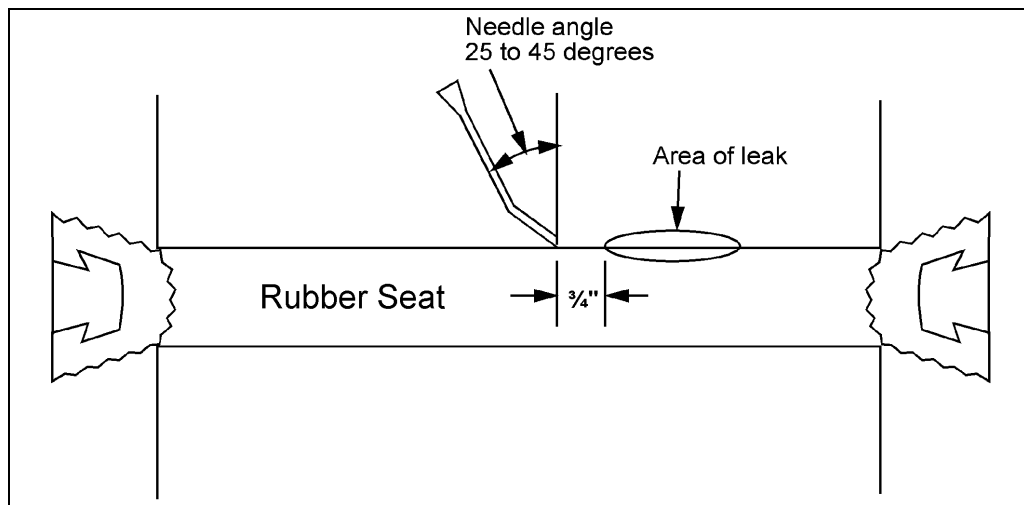


Figure 1 - Selecting Injection Site

3. Holding the needle insertion tool 25–45 degrees from perpendicular to the rubber seat, place the tip of the needle against the seat and as close to the body as possible.
4. Push the needle through the rubber seat until it stops against the original epoxy inside the rubber seat.

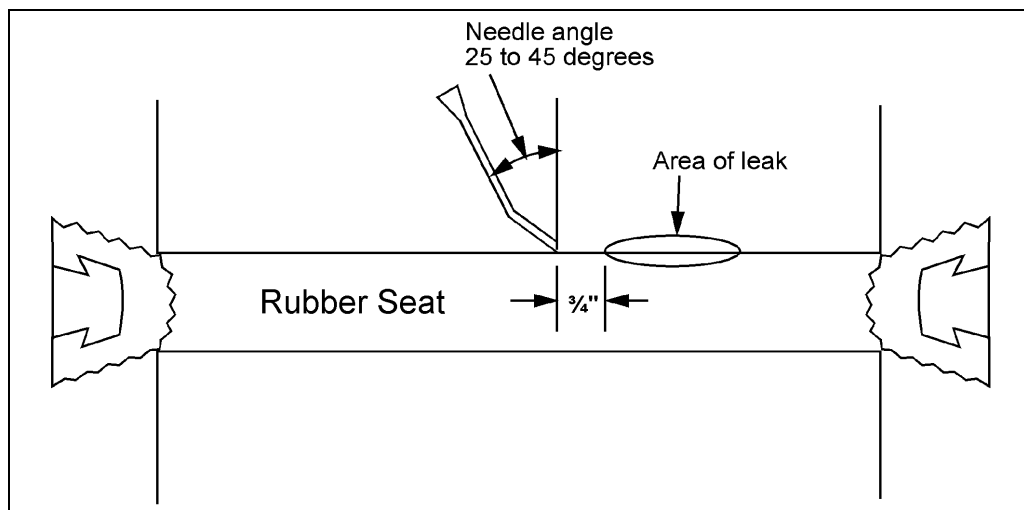


Figure 2 - Needle in Position for Injecting Epoxy into Rubber Seat

Note: The needle position needs to match figure 2 exactly, otherwise the rubber seat can block the flow of epoxy out of the needle.

Seat Adjustment *(Continued)*

5. Inject the epoxy until the leak stops.

Note: If the leak doesn't stop, reposition the needle and try again.

6. Pump two extra strokes of the grease gun to ensure the epoxy seals the hole from the needle and withdraw the needle.

Note: Be sure to release the pressure on the gun before withdrawing the needle. A small amount of epoxy will come to the surface of the seat. Wipe as much off as possible before it cures.

7. With the disc in the closed position, allow the epoxy to cure for a minimum of four hours at room temperature — allow more time for cooler temperatures.

Note: Insert the shaft carefully so that the lower bearing (A17) is not damaged, or moved out of position.

Waste Disposal

Mixed epoxy can be disposed of in a regular manner, but unmixed resin and catalyst are considered hazardous waste.

1. Remove the needle from the valve, and dispose of properly.
2. Store any unused epoxy or resin properly, or dispose of the materials according to applicable hazardous materials regulations and procedures.

Guarantee

Products, auxiliaries and parts thereof of Sartell Valves, Inc. manufacture are warranted to the original purchaser for a period of twenty-four (24) months from date of shipment from factory, against defective workmanship and material, but only if properly installed, operated and serviced in accordance with Sartell Valves, Inc. recommendations. Repair or replacement, at our option, for items of Sartell Valves, Inc. manufacture will be made free of charge, (FOB) our facility with removal, transportation and installation at your cost, if proved to be defective within such time, and this is your sole remedy with respect to such products. Equipment or parts manufactured by others but furnished by Sartell Valves, Inc. will be repaired or replaced, but only to the extent provided in and honored by the original manufacturers warranty to Sartell Valves, Inc., in each case subject to the limitations contained therein. No claim for transportation, labor or special or consequential damages or any other loss, cost or damage shall be allowed. You shall be solely responsible for determining suitability for use and in no event shall Sartell Valves, Inc. be liable in this respect. Sartell Valves, Inc. does not guarantee resistance to corrosion, erosion, abrasion or other sources of failure, nor does Sartell Valves, Inc. guarantee a minimum length of service. Your failure to give written notice to us of any alleged defect under this warranty within twenty (20) days of its discovery, or attempts by someone other than Sartell Valves, Inc. or its authorized representatives to remedy the alleged defects therein, or failure to return product or parts for repair or replacement as herein provided, or failure to install and operate said products and parts according to instructions furnished by Sartell Valves, Inc., or misuse, modification, abuse or alteration of such product, accident, fire, flood or other Act of God, or failure to pay entire contract price when due shall be a waiver by you of all rights under this warranty.

The foregoing guarantee shall be null and void if, after shipment from our factory, the item is modified in any way or a component of another manufacturer, such as but not limited to, an actuator is attached to the item by anyone other than Sartell Valves, Inc. Factory Service personnel. All orders accepted shall be deemed accepted subject to this limited warranty, which shall be exclusive of any other or previous Warranty, and this shall be the only effective guarantee or warranty binding on Sartell Valves, Inc., despite anything to the contrary contained in the purchase order or represented by any agent or employee of Sartell Valves, Inc., in writing or otherwise, notwithstanding, including but not limited to implied warranties.

THE FOREGOING REPAIR AND REPLACEMENT OBLIGATIONS ARE IN LIEU OF ALL OTHER WARRANTIES, OBLIGATIONS AND LIABILITIES, INCLUDING ALL WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR OF MERCHANTABILITY OR OTHERWISE, EXPRESSED OR IMPLIED IN FACT OR BY LAW, AND STATE SARTELL VALVES, INC.'S ENTIRE AND EXCLUSIVE LIABILITY AND YOUR EXCLUSIVE REMEDY FOR ANY CLAIM IN CONNECTION WITH THE SALE AND FURNISHING OF SERVICES, GOODS OR PARTS, THEIR DESIGN, SUITABILITY FOR USE, INSTALLATION OR OPERATIONS.

Limitation of liability

LIMITATION OF LIABILITY: IN NO EVENT SHALL SARTELL VALVES, INC. BE LIABLE FOR ANY DIRECT, INDIRECT, SPECIAL OR CONSEQUENTIAL DAMAGES WHATSOEVER, AND SARTELL VALVES, INC.'S LIABILITY, UNDER NO CIRCUMSTANCES, WILL EXCEED THE CONTRACT PRICE FOR THE GOODS AND/OR SERVICES FOR WHICH LIABILITY IS CLAIMED. ANY ACTION BY YOU FOR BREACH OF CONTRACT MUST BE COMMENCED WITHIN 12 MONTHS AFTER THE DATE OF SALE.

Sales and Service

For information about our worldwide locations, approvals, certifications and local representative:

Web site: www.sartellvalves.com

E-Mail: info@sartellvalves.com

SARTELL Valves, Inc.



250 Riverside Ave. N., Sartell, MN 56377 • Phone: 320-259-2000 • Fax: 320-259-2227

Sartell Valves, Inc. reserves the right to incorporate our latest design and material changes without notice or obligation. Design features, materials of construction and dimensional data, as described in this manual, are provided for your information only and should not be relied upon unless confirmed in writing by Sartell Valves, Inc. Certified drawings are available upon request.